



SECTION A-A

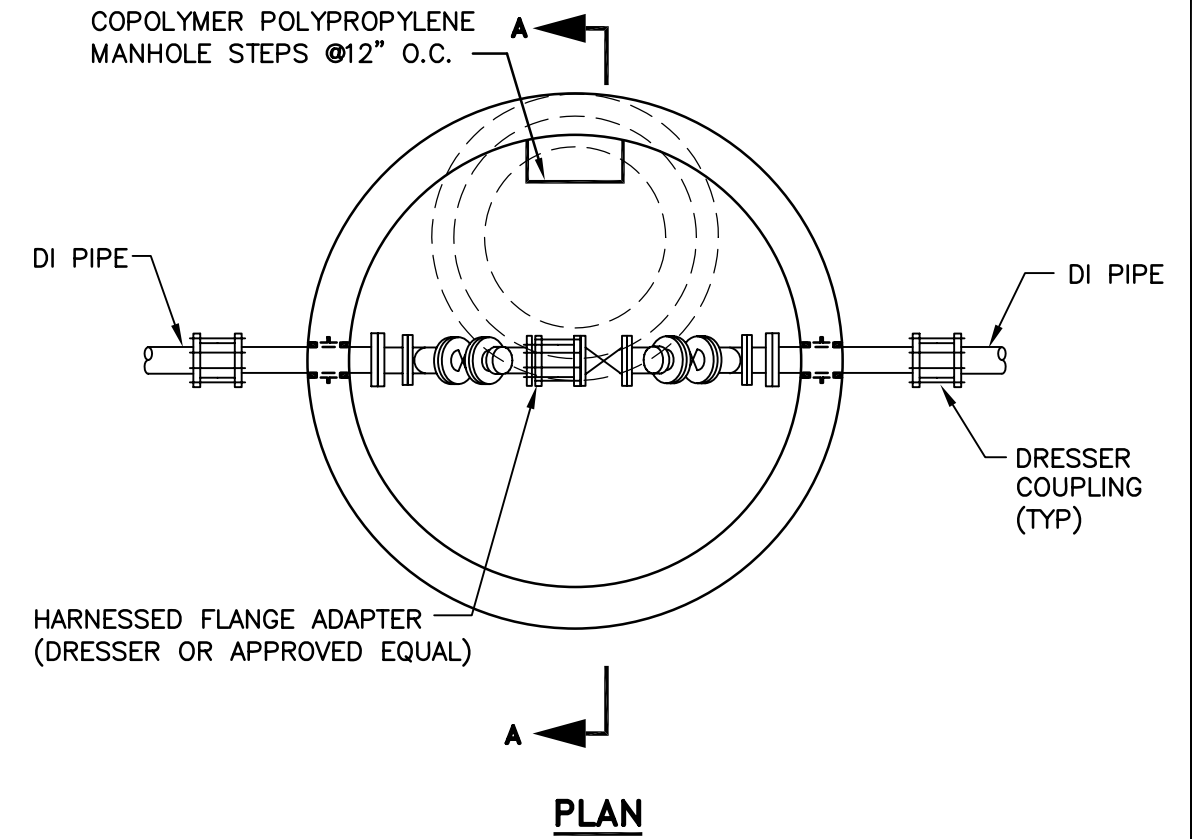

PLAN

STANDARD NOTES:

1. SIZE OF INTERNAL DUCTILE IRON PIPING TO MATCH DIAMETER OF FORCE MAIN PIPE SIZE (4" MIN).
2. REFER TO SECTION 02530 FOR ADDITIONAL REQUIREMENTS ASSOCIATED WITH FORCE MAIN SEWER PRECAST STRUCTURES.
3. USE A MINIMUM OF 8'-0" DIAMETER STRUCTURE REGARDLESS OF FORCE MAINS PIPE SIZES.

 <p>Water Pollution Control Authority Town of Canton</p> <p>4 Market Street P.O. Box 168 Collinsville, Connecticut 06022</p>	SEWER CONSTRUCTION DETAIL	
	FORCE MAIN TWO-WAY CLEANOUT STRUCTURE	
LATEST REVISION: 2/07	NO SCALE	
		NO. 040